

3,200 LITRE SEPTIC TANK

Installation Instructions

3

- Excavate hole and line with 100mm of clean sand.
- Lower the tank into the hole and FILL WITH WATER.
- Fix manhole cover to upstand with four stainless steel screws

4


· Backfill using sand or similar with special attention to underside of anti-flotation flange.

NEVER BACKFILL BEFORE FILLING TANK WITH WATER

IMPORTANT

- Septic tank to be buried NO more than 500mm beneath ground level surface.
- NEVER completely pump the tank out. Always leave at least 800mm liquid depth within the tank.
- · Septic tank MUST have applicable protective cover for trafficable areas. See manufacture for further details


This septic tank has been manufactured to Australian Standard AS/NZS 1546.1

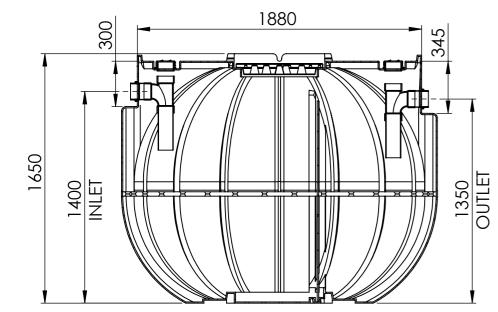


SECTIO A-A

D

Е

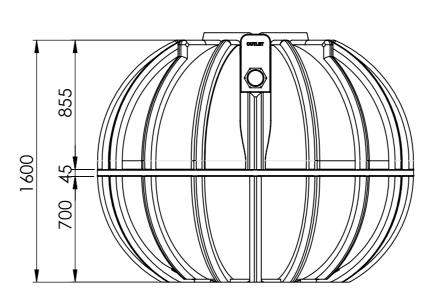

SIDE VIEW



INTERNAL

BAFFLE

5

